


Troldtekt®

Rqo lct' r qej žcplkplc' f y k nwf rē<
20 mm Troldtekt, 40 mm y gžpc' o kpgtcrpc.
r wlvnr' r qy kvgt| pc 260 mm

SCHEMAT PRZEKROJU POPRZECZNEGO

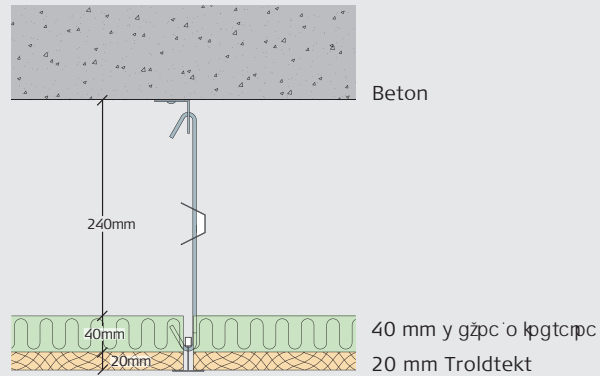

RQOKT' RQEJ ŽCPKPC' F Y K MW


Rqo lct' y ur ōze| {ppknc' r qej žcplkplc' f y k nw r t| gr tqy cf | qpq' y' nqo qt| g' r qi žquqy gl' / | i qf plg' | ' KUQ' 576' 1' F UO

Rqo lct' | quvcž| y {nqpcpg' r t| g| ' F GNC' Ceqwvkeu' (Xldtcvkap' C1UO

Hz	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150	4000	5000
α	0,46	0,65	0,72	0,83	0,86	0,94	1,00	0,91	0,88	0,98	1,00	0,94	0,93	0,91	0,86	0,86	0,90	0,95

α_w ? '2; 7'—PTE' ? '2; 2' / M'cuc' cduqtr elkCO

Y ur ōze| {ppknc' duqtr elkCO

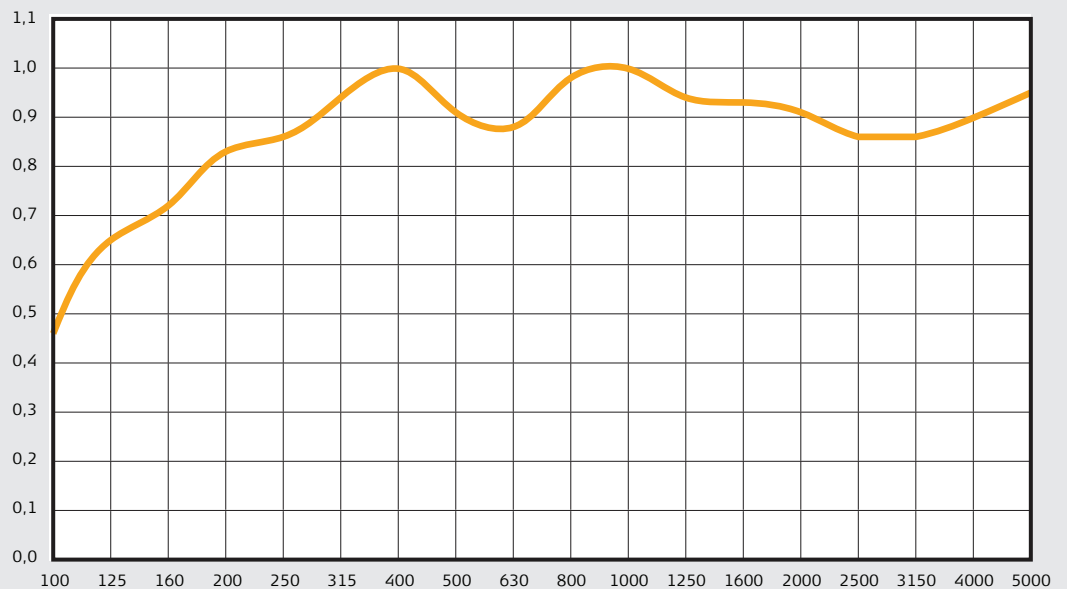

E| uqvily q .U|